MOHAVE COUNTY
DEVELOPMENT SERVICES

P. O. Box 7000 Kingman, Arizona 86402-7000 3250 E. Kino Ave, Kingman www.mohave.gov Telephone (928) 757-0903

Scott Holtry
Department Director

J. David Strahl
County Manager

NOTICE OF INTENT TO DISCHARGE
ON-SITE WASTEWATER TREATMENT FACILITY
INSTRUCTIONS

Submit Notice of Intent to Discharge (NOI) to obtain authorization to construct and operate a septic tank and disposal field under a Type 4.02-4.22 General Aquifer Protection Permit in accordance with **Arizona Administrative Code (A.A.C.) R18-9-Article 3.**

The following must be submitted to complete an application for an onsite wastewater treatment facility. **Payment is due at the time of submittal** and is not refundable, permits are not transferable.

Requirements for submitting a complete on-site wastewater application must include:

- Mohave County Permit Application Worksheet
- Notice of Intent to Discharge
- Fixture Count Calculation Chart Worksheet
- Design Configuration Sheet
- Draft Operation and Maintenance Manual (Alternative Systems Only)
- On-site Wastewater Facility Plot Plan ****Use Engineer's Scale – MAX. 1 inch = 60 feet****
- Site Plan (Commercial Only)
- Sewer Availability Sheet
- Temporary Agreement
- List of Materials and Components for constructing the on-site wastewater facility
- Property Floodplain Information Sheet **(PFI)** email: MCFloodInfo@mohave.gov
- Site Investigation Report

GENERAL APPLICATION PROCESS

The application will be reviewed to ensure it is administratively complete. Then reviewed for technical compliance. Once all requirements have been met, a Construction Authorization (CA) will be issued to the applicant. CA must be signed and returned, then construction may begin of the on-site wastewater facility.

****Alternative & Commercial Systems must be installed by a contractor licensed for this type of work****
Construction **MUST** be completed, and a Request for Discharge Authorization (RDA) must be submitted within **2 years** to request an inspection of the facility. **The following must be submitted with the RDA**:

1. RDA form with Certification that the septic tank passed watertightness test after installation.
2. Final as-built plot plan of the project if it differs from the proposed plan.
3. Certificate of Completion or (ECC) (Alternative Systems Only)

When the above documents are received, an inspector will inspect the facility. If the facility was constructed according to the approved plan in compliance with all applicable State laws and local regulations, a Discharge Authorization (DA) will be issued.

FEES

Fees for Type 4 General Permits (4.02 through 4.22) are listed on website: Mohave County Septic Permitting

If an applicant requests priority review, the Department shall approve or deny the request. The Department will only consider requests where environmental nuisances of occupied properties exist. The request must be accompanied by a failed NAWT inspection report. When determining whether to approve a priority review request The Department shall consider the complexity of the project and the Department's current workload.

LICENSING TIME FRAMES

Licensing Time Frames (LTFs) are specified by the Arizona Department of Environmental Quality in A.A.C. R18-1-525. The following LTFs limit the number of business days ADEQ can review your project without a penalty:

License Type	Administrative Completeness Review	Substantive Review	Overall Time Frame
Single 4.02, 4.03, 4.13, and 4.14 General Permits	42	31	73
Combined Two or Three Type 4 General Permits	42	53	95
Combined Four or More Type 4 General Permits	42	94	136

- Each request for an alternative design, installation, or operational feature under A.A.C. R18-9-A312(G) to a type 4 general permit adds eight business days to the substantive review timeframe.

Notes:

1. Construction of the facility CANNOT take place until the Construction Authorization is issued.
2. Discharge CANNOT take place until the Discharge Authorization is issued.
3. If the construction differs from the proposed plan, and a second inspection and/or second review of the system is necessary, additional fees may apply.
4. A Sewer Availability Information Sheet is required from the sewer provider for the property location. This **MUST** be done **PRIOR** to having a site investigation and must be attached to the application submittal.

Mailing Address: DEVELOPMENT SERVICES P.O. Box 7000, Kingman, AZ 86402-7000

Mohave County
Onsite Wastewater Treatment Facility
Permit Application Worksheet

Date_____

Project # _____

Permit # _____

PLOT PLANS MUST BE NO LARGER THAN 8 ½ " X 11"
NOTE: Shaded areas are for county use only.

1. Type of Improvement: _____
2. Applicant's name: _____
   Mailing address: _____
   City: _____ State: _____ Zip: _____
2A. Contact Name: _____ **PHONE**: _____
   Fax Number: _____ Email: _____
3. Property Owners Name: _____
   Mailing Address: _____
   City: _____ State: _____ Zip: _____
   Fax Number: _____ Email: _____

4. **SITE LOCATION ADDRESS**: _____ _____ _____
   House No Street Dir Street Name:
5. Legal Description:

   Assessor Parcel Number: ___ ___ ___ - ___ ___ - ___ ___ ___ ___ Parent Parcel: ☐ Yes
   Subdivision Name: _____ Corner Lot: ☐ Yes
   Unit/Tract/Block/Lot: _____ -- _____ -- _____
   Township/Range/Section: _____ -- _____
6. Plot Plan Drawing (see instructions on plot plan form)

Public Works, Flood Control Division

7. Is there an existing structure? ☐ YES ☐ NO
7A. Previous PFI#: _____ Previous FUP#: _____

Environmental Quality Division

8. Is this an existing system? ☐ YES ☐ NO
8A. Is this a Conventional Septic? ☐ YES ☐ NO, Alternative System? ☐ YES ☐ NO
9. Septic Tank Size: _____ Manufacturer: _____
10. Septic Contractor: _____ License #: _____
    Or Owner / Builder: ☐ YES ☐ NO

Number of bedrooms:_____

Number of fixture units:_____

Planning & Zoning Division

12. Zoning: _____

BAL DUE $_____

Note: Must provide scaled construction drawings for Development Services application

GENERAL INFORMATION

1 Project Name

Project Name

2 Applicant (person responsible for overall compliance)

(Check One) ☐ Owner ☐ Operator

3 Site Information

Location of proposed tank site

Latitude _____º _____‘ _____“ N Longitude _____º _____‘ _____“ W

Legal Description of Property _____.

Water Supply (check one):

- ☐ Public Water
- ☐ Private Well *See Note may require letter
- ☐ Haul Water *See Note may require letter

Wash or drainage easement: If system is proposed within the 50-foot setback required by the Aquifer Protection Permit, a letter must be obtained from the appropriate flood plain administrator allowing a reduction of the setback.

If applicable a letter from floodplain administrator must be included in the application packet.

4 Existing Environmental Permits

List any other federal or state environmental permits issued for or needed by the facility, including any individual permit, Groundwater Quality Protection Permit, or Notice of Disposal that may have previously authorized the discharge (attach additional pages if necessary).

5 Review Fees

- ☐ Standard Review Fee (See Instructions)
- ☐ Request for priority review for this NOI and include failed NAWT Inspection report.

SUPPLEMENTAL INFORMATION

6 Information and Submission Requirements (Check All Completed Items)

- ☐ Site Investigation Report per A.A.C. R18-9-A309(B)(1)
- ☐ Plot Plan per A.A.C. R18-9-A309(B)(2)

7 Design Flow and Strength of Wastewater

A) Design flow per A.A.C. R18-9-A309(B)(3) _____gallons per day. Soil Absorption Rate (SAR) _____gallons per day.

B) The expected strength of the wastewater (if the strength exceeds the levels for typical sewage) is attached? ☐ Yes

☐ **Residential**

For single family dwelling, a list of the number of bedrooms and plumbing fixtures and corresponding unit flows used to calculate the design flow of the facility per A.A.C. R18-9-A314

Wastewater Source	Number	Unit Flows used to calculate the design flow of the facility
Bedrooms		
Plumbing Fixtures		

☐ **Commercial** (or dwelling over 8 bedrooms or 56 fixture units)

For a dwelling other than for a single family, a list of each wastewater source and corresponding unit flows used to calculate the design flow of the facility. (See Table 1)

Wastewater Source	Number	Unit Flows used to calculate the design flow of the facility

8 List of Materials and Components

A list of material and components for constructing the onsite wastewater treatment facility is attached? ☐ Yes

*Public Water note: If no public water is available, and system is located less than 50 ft. from any property line, applicant must obtain an agreement from the owners of any affected undeveloped adjacent property to limit the location of any new well on their property to at

least 100 feet from the proposed treatment works and primary and reserve disposal works. The agreement must be recorded appropriately, and the documentation must be approved by the Department.

9 Selected General Permits (Check All General Permits that Are being Applied for)

☐ **Alternative Request(s) are attached (A.A.C. R18-9-A312(G))**

Please indicate how many A312G requests are attached _____ .

☐ **4.02 Septic Tank with Disposal by Trench, Bed, Chamber Technology, or EZ Flow. Less than 3,000 Gallons per Day (GPD) Daily Flow**

A) This on-site wastewater treatment facility consists of a conventional septic tank system and disposal field sized for a design flow of_____gallons per day. The septic tank conveys wastewater to a disposal field consisting of (check one):
   1. ☐ Trench
      a. ☐ Filled with aggregate [A.A.C. R18-9-101(1)], or
      b. ☐ Filled with crushed, recycled concrete [A.A.C. R18-9-E302(C)(2)(d)]
   2. ☐ Bed
   3. ☐ Chamber technology
   4. ☐ EZFlow

B) The date the system is expected to start operation_____.

C) The sewage to the septic tank has the characteristics of ☐ Typical household sewage or ☐ Typical household sewage and _____

D) This on-site wastewater treatment facility is for (check one):
   ☐ Conventional septic tank system serving a single-family residence.
   ☐ Conventional septic tank system serving other than a single-family residence.

☐ **4.03 Composting Toilet, Less than 3,000 GPD Daily Flow (Please select from Product List)**

A) Composting toilet system manufacturer name _____

B) Composting toilet system manufacturer address _____

C) A copy of the manufacturer's warranty, and the specifications for installation, operation, and maintenance has been provided? ☐ Yes

D) The product model number _____

E) Calculations for the composting rate, capacity, and waste accumulation volume are attached? ☐ Yes

F) Documentation of listing by a national listing organization indicating that the composting toilet meets the stated manufacturer's specifications for loading, treatment performance, and operation has been attached (unless the composting toilet is listed under R18-9-A309(E) or is a component of a reference design approved by the Department)? ☐ Yes

G) Describe the vector control method.

H) Describe the planned method and frequency for disposing of the composted human excrement residue.

_____

I) Describe the planned method for disposing of the drainage from the composting unit.

_____

J) The number of bedrooms in the dwelling or persons served on a daily basis, as applicable. _____

K) What is the corresponding design flow of the disposal works for the wastewater? _____

L) The results from soil evaluation or percolation testing that adequately characterize the soils into which the wastewater will be dispersed and the locations of soil evaluation and percolation testing on the site plan have been provided? ☐ Yes

M) The design for the disposal including the location of the interceptor, the location and configuration of the trench or bed used for wastewater dispersal, the location of connecting wastewater pipelines, and the location of the reserve area has been provided? ☐ Yes

☐ **4.04 Pressure Distribution System, Less than 3,000 GPD Daily Flow**

A) A copy of operation, maintenance, and warranty materials for the principal components has been attached? ☐ Yes

B) A copy of dosing specifications, including pump curves, dispersing component curves, and float switch settings is attached? ☐ Yes

☐ **4.05 Gravelless Trench, Less than 3,000 GPD Daily Flow**

A) The soil absorption area that would be required if a conventional disposal trench filled with aggregate was used at the site? ☐ Yes

B) The configuration and size of the proposed gravelless disposal field is attached? ☐ Yes

C) The manufacturer's installation instructions and warranty of performance for absorbing wastewater into the native soil is attached? ☐ Yes

☐ **4.06 Natural Seal Evaporative Bed, Less than 3,000 GPD daily Flow**

A) Capillary rise potential test results for the media used to fill the evapotranspiration bed, unless sand meeting a D50 of 0.1 millimeter (50 percent by weight of grains equal to or smaller than 0.1 millimeter) is used? ☐ Yes

B) Water mass balance calculations were used to size the evapotranspiration bed? ☐ Yes

☐ **4.07 Lined Evapotranspiration Bed, Less than 3,000 GPD Daily Flow**

A) Capillary rise potential test results for the media used to fill the evapotranspiration bed, unless sand meeting a D50 of 0.1 millimeter (50 percent by weight of grains equal to or smaller than 0.1 millimeter) is used? ☐ Yes

B) Water mass balance calculations were used to size the evapotranspiration bed? ☐ Yes

☐ **4.08 Wisconsin Mound, Less than 3,000 GPD Daily Flow**

A) Specifications for the internal wastewater distribution system media proposed for use in the mound are attached? ☐ Yes

B) Two scaled or dimensioned cross sections of the mound (one of the shortest basal area footprint dimension and one of the lengthwise dimension) are attached? ☐ Yes

C) Design calculations following the "Wisconsin Mound Soil Absorption System: Siting, Design, and Construction Manual," published by the University of Wisconsin - Madison, January 1990 Edition have been provided? ☐ Yes

☐ **4.09 Engineered Pad, Less than 3,000 GPD Daily Flow**

A) Design materials and construction specifications for the engineered pad system are attached? ☐ Yes

☐ **4.10 Intermittent Sand Filter, Less than 3,000 GPD Daily Flow**

A) Specifications for the media proposed for use as the sand filter are attached? ☐ Yes

☐ **4.11 Peat Filter, Less than 3,000 GPD Daily Flow (Please select from Product List)**

A) Specifications for the peat media proposed for use in the filter or provided in the peat module, including the porosity, surface area, and moisture content are attached? ☐ Yes

B) A statement indicating whether the peat is air dried, and whether the peat is from sphagnum moss or bog cotton is attached? Yes ☐

C) A description of the degree of decomposition is attached? ☐ Yes

D) Specifications for installing the peat media are attached? ☐ Yes

E) If a peat module is used, the name and address of the manufacturer, the model number, and a copy of the manufacturer's warranty are attached? ☐ Yes

☐ **4.12 Textile Filter, Less than 3,000 GPD Daily Flow (Please select from Product List)**

A) Filter manufacturer name _____

B) Filter manufacturer address _____

C) Filter model number _____

D) A copy of the manufacturer's filter warranty is attached? ☐ Yes

E) If the system is for nitrogen reduction to 15 milligrams per liter, five-month arithmetic mean, specifications on the nitrogen reduction performance of the filter system, and corroborating third-party test data is attached? ☐ Yes

F) The manufacturer's operation and maintenance recommendations to achieve a 20-year life are attached? ☐ Yes

G) If a pump or aerator is required for proper operation, the pump or aerator model number and a copy of the manufacturer's warranty is attached? ☐ Yes

H) The design report has demonstrated there is adequate storage for untreated wastewater above the high operating level for a 24-hour period per AAC R18-9-E312 (B)(4)(e)? ☐ Yes

I) The design provides fail-safe wastewater controls or operational processes to prevent the release of inadequately treated wastewater per AAC R18-9-E312 (B)(4)(g)? ☐ Yes

☐ **4.13 Denitrifying System Using Separated Wastewater Streams, Less than 3,000 GPD Daily Flow**

☐ **4.14 Sewage Vault, Less than 3,000 GPD Daily Flow**

☐ **4.15 Aerobic System, Less than 3,000 GPD Daily Flow (Please select from Product List)**

A) Aerobic system manufacturer name _____

B) Aerobic system manufacturer address _____

C) Aerobic system model number _____

D) Evidence of performance specified in AAC R18-9-E315(B) has been attached? ☐ Yes

E) A copy of the manufacturer's warranty and operation and maintenance recommendations to achieve performance for a 20-year life has been attached? ☐ Yes

F) If the aerobic system will be used for nitrogen removal from the wastewater, has evidence of a valid product listing under R18-9-E309(E) indicating nitrogen removal performance, or specifications and third-party test data corroborating nitrogen reduction to the intended level been provided? ☐ Yes

G) A list of pretreatment components needed to meet performance requirements has been attached? ☐ Yes
H) The design report has demonstrated there is adequate storage for untreated wastewater above the high operating level for a 24-hour period per AAC R18-9-E312 (B)(4)(e)? ☐ Yes
I) The design provides fail-safe wastewater controls or operational processes to prevent the release of inadequately treated wastewater per AAC R18-9-E312 (B)(4)(g)? ☐ Yes

☐ **4.16 Nitrate-Reactive Media Filter, Less than 3,000 GPD Daily Flow (Please select from Product List)**

A) Filter manufacturer name _____
B) Filter manufacturer address _____
C) Filter model number _____
D) The manufacturer's requirements for pretreated wastewater supplied to the nitrate-reactive media filter have been attached? Yes ☐
E) The manufacturer's specifications for design, installation, and operation for the nitrate-reactive media filter system and appurtenances have been attached? ☐ Yes
F) The manufacturer's warranty for the nitrate-reactive media filter system and appurtenances has been attached? ☐ Yes
G) The manufacturer's operation and maintenance recommendations to achieve a 20-year operational life for the nitrate-reactive media filter system and appurtenances have been attached? ☐ Yes
H) The manufacturer name and model number for all appurtenances that significantly contribute to achieving the performance have been attached? ☐ Yes

☐ **4.17 Cap System, Less than 3,000 GPD Daily Flow**

A) The specifications for the proposed cap fill material have been attached? ☐ Yes

☐ **4.18 Constructed Wetlands, Less than 3,000 GPD Design Flow**

☐ **4.19 Sand Lined Trench, Less than 3,000 GPD Design Flow**

A) Specifications for the proposed media in the trench are attached? ☐ Yes

☐ **4.20 Disinfection Devices, Less than 3,000 GPD Design Flow**

☐ **4.21 Surface Disposal, Less than 3,000 GPD Design Flow**

☐ **4.22 Subsurface Drip Irrigation, Less than 3,000 GPD Design Flow**

A) Documentation of the pretreatment method proposed to achieve the wastewater criteria specified in AAC R18-9- A322(B)(1), such as the type of pretreatment system and the manufacturer's warranty is attached? ☐ Yes
B) Initial filter and drip irrigation flushing settings are attached? ☐ Yes
C) Calculations of the site evaporation rate are attached? ☐ Yes
D) If supplemental irrigation water is introduced to the subsurface drip irrigation disposal works, an identification of the cross-connection controls, backflow controls, and supplemental water sources are attached? ☐ Yes

10 Additional On-site Requirements (for Type 4.03 through 4.22 General Permits)

A) For a facility that includes treatment or disposal works permitted under a Type 4.03 to 4.22 General Aquifer Protection Permits (A.A.C. R18-9-E303 through R18-9-E323):
1) Construction quality drawings that show the items listed in A.A.C. R18-9-A309(B)(6)(a) is attached? ☐ Yes
2) Per A.A.C R18-9-A309(B)(6)(b) and R18-9-A313(B), a draft operation and maintenance manual for the on-site wastewater treatment facility consisting of the tasks and schedules for operating and maintaining performance over a 20-year operational life is attached? ☐ Yes

11 Alternative treatment works or disposal works

☐ Owner has provided signed statement form acknowledging use of an alternative treatment works or disposal works in lieu of a conventional treatment works or disposal works.

12 Certification (to be completed by Applicant on Permit Application Worksheet)

I,_____, certify that this Notice of Intent to Discharge and all attachments were prepared under my direction or authorization and all information is, to the best of my knowledge, true, accurate and complete. I also certify that the on-site wastewater treatment facility described in this form is or will be designed, constructed, and operated in accordance with the terms and conditions the General Aquifer Protection Permit(s) (A.A.C. R18-9-E302 through R18-9-E323) and applicable requirements of Arizona Revised Statutes Title 49, Chapter 2, and Arizona Administrative Code Title 18, Chapter 9 regarding Aquifer Protection Permits. I am aware that there are significant penalties for submitting false information including permit revocation as well as the possibility of fine and imprisonment for knowing violations.

_____ _____

Signature Date

FOR RESIDENTIAL USE

FIXTURE COUNT CALCULATION CHART

Use the fixture count chart below to determine the total number of fixture units in the home. **Check the corresponding box on the system design flow chart based on your fixture count or number of bedrooms *whichever is greater*.** The box that is checked is the row where you'll find your minimum tank size and system design flow. Enter the information at the bottom of the page, and submit this form with your application.

Residential Fixture Type	Existing # Fixtures	Proposed # Fixtures	Multiply by	Fixture Units	Equals	Total # PROPOSED Fixtures
Bathtub			x	2	=	
Bidet			x	2	=	
Dishwasher, outside kitchen			x	2	=	
Clothes washer			x	2	=	
Utility tub or sink separate from clothes washer			x	2	=	
Kitchen Sink (may include dishwasher)			x	2	=	
Shower, single stall			x	2	=	
Sink, bar			x	1	=	
Sink, service			x	3	=	
Lavatory, single or double (bathroom sink)			x	1	=	
*Toilet, 1.6 gallons per flush (gpf)			x	3	=	
*Toilet, 1.6 - 3.2 gpf			x	4	=	
*Toilet >3.2 gpf			x	6	=	
				FIXTURE COUNT TOTAL	=	
				Physical # Bedrooms	=	

*Toilets currently available in Arizona are 1.6 gallons per flush. Older fixtures may not use the same amount of gallons per flush.

SYSTEM DESIGN FLOW CHART

✓	No. of Bedrooms	Fixture Count	Minimum Tank Size (gallons)	System Design Flow (gpd)
☐	1	7 or less	1000	150
☐		More than 7 less than 14	1000	300
☐	2	14 or less	1000	300
☐		More than 14 less than 21	1000	450
☐	3	21 or less	1000	450
☐		More than 21 less than 28	1250	600
☐	4	28 or less	1250	600
☐		More than 28 less than 35	1500	750
☐	5	35 or less	1500	750
☐		More than 35 less than 42	2000	900
☐	6	42 or less	2000	900
☐		More than 42 less than 49	2500	1050
☐	7	49 or less	2500	1050
☐		More than 49 less than 56	3000	1200
☐	8*	56 or less	3000	1200
☐		More than 56*	3000	1350

***NOTE: For a single residence with more than 8 bedrooms or more than 56 fixture units, use R18-9-A314 (D) (2) as the basis for determining minimum septic tank size and system design flow.**

For Commercial Use

(or dwelling over 8 bedrooms or 56 fixture units)

Wastewater Source	Applicable Unit	Sewage Design Flow per Applicable Unit.
Airport	Passenger (average daily number) Employee	4 15
Auto Wash	Facility	Per manufacturer, if consistent with this
Bar/Lounge	Seat	30
Barber Shop	Chair	35
Beauty Parlor	Chair	100
Bowling Alley (snack bar only)	Lane	75
Camp Day camp, no cooking facilities Campground, overnight, flush toilets Campground, overnight, flush toilets and Campground, luxury Camp, youth, summer, or seasonal	 Camping unit Camping unit Camping unit Person Person	 30 75 150 100-150 50
Church Without kitchen With kitchen	 Person (maximum attendance) Person (maximum attendance)	 5 7
Country Club	Resident Member Nonresident Member	100 10
Dance Hall	Patron	5
Dental Office	Chair	500
Dog Kennel	Animal, maximum occupancy	15
Dwelling For determining design flow for sewage treatment facilities under R18-9-B202(A)(9)(a) and sewage collection systems under R18-9-E301(D) and R18-9- B301(K), excluding peaking factor.	Person	80
Dwelling For on-site wastewater treatment facilities per R18-9- E302 through R18-9-E323: Apartment Building 1 bedroom 2 bedroom 3 bedroom 4 bedroom Seasonal or Summer Dwelling (with recorded seasonal occupancy restriction) Single Family Dwellings Other than Single Family Dwelling, the greater flow value based on: Bedroom count 1-2 bedrooms Each bedroom over 2 Fixture count	 Apartment Apartment Apartment Apartment Resident see R18-9-A314(D)(1) Bedroom Bedroom Fixture unit	 100 see R18-9-A314(D)(1) 300 150 25
Fire Station	Employee	45
Hospital All flows Kitchen waste only Laundry waste only	 Bed Bed Bed	 250 25 40
Hotel/motel Without kitchen With kitchen	 Bed (2 person) Bed (2 person)	 50 60

Industrial facility		
Without showers	Employee	25
With showers	Employee	35
Cafeteria, add	Employee	5
Institutions		
Resident	Person	75
Nursing home	Person	125
Rest home	Person	125
Laundry		50
Self service	Wash cycle	Per manufacturer, if consistent with this Chapter
Commercial	Washing machine	
Office Building	Employee	20
Park (temporary use)		
Picnic, with showers, flush toilets	Parking space	40
Picnic, with flush toilets only	Parking space	20
Recreational vehicle, no water or sewer	Vehicle space	75
Recreational vehicle, with water and sewer connections	Vehicle space	100
Mobile home/Trailer	Space	250
Restaurant/Cafeteria	Employee	20
With toilet, add	Customer	7
Kitchen waste, add	Meal	6
Garbage disposal, add	Meal	1
Cocktail lounge, add	Customer	2
Kitchen waste disposal service, add	Meal	2
Restroom, public	Toilet	200
School		
Staff and office	Person	20
Elementary, add	Student	15
Middle and High, add	Student	20
with gym & showers, add	Student	5
with cafeteria, add	Student	3
Boarding, total flow	Person	100
Service Station with toilets	First bay	1000
	Each additional bay	500
Shopping Center, no food or laundry	Square foot of retail space	0.1
Store	Employee	20
Public restroom, add	Square foot of retail space	0.1
Swimming Pool, Public	Person	10
Theater		
Indoor	Seat	5
Drive-in	Car space	10

Note: Unit flow rates published in standard texts, literature sources, or relevant area or regional studies are considered by the Department, if appropriate to the project.

DISPOSAL FIELD DESIGN/CONFIGURATION

Trench or Gravity Bed

PROJECTED SEWAGE FLOW: _____ g.p.d. / SOIL ABSORBTION RATE (SAR): _____

ABSORPTION AREA: _____


Trench Configuration

Please indicate vertical depths using inches.

A. Backfill to final grade …….. _____
   A-1 [Graded soil area, state using a (-) sign] _____
   A-2 [Fill or topsoil, state using a (+) sign] _____
B. Distribution pipe w/ 2" of rock _____
C. Aggregate depth (effective depth) _____

D. Total trench depth _____


Trench width _____
Total length of trench _____ (ft.)

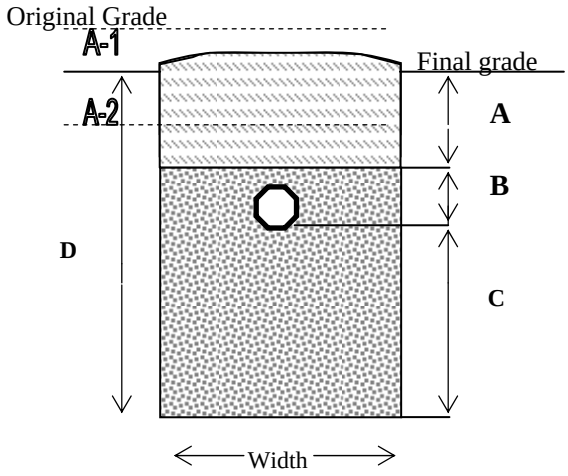

Gravity Beds

A. Backfill _____
B. Distribution line with 2" of aggregate material _____
C. Aggregate depth _____
D. Total Bed depth _____
   (Gravity Bed **shall** be less than 5' total depth)

Trench width 10' or 12' (circle one)
Distance between pipes 4' or 6' **(**circle one)
Total length of Bed _____

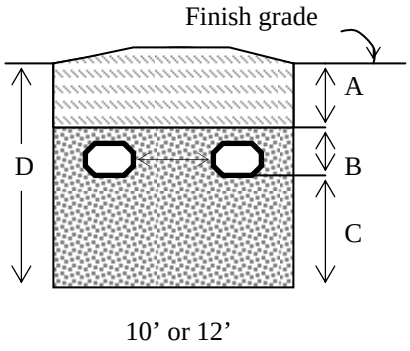

Infiltrator Chamber Worksheet

Permit/File #: _____ Designed by: _____ Date: _____

FIXTURE COUNT CALCULATION CHART					
FIXTURE TYPE	*UNIT*		*# OF FIXTURES*		*TOTAL FIXTURE UNITS*
Bath Tub	**2**	X		=	
Bidet	2	X		=	
Clothes Washer	**2**	X		=	
Dishwasher (separate from kitchen)	2	X		=	
Lavatory (bathroom sink), single	**1**	X		=	
Lavatory, double in master bedroom	**1**	X		=	
Shower, single stall	**2**	X		=	
Sink, bar	**1**	X		=	
Sink, kitchen (including dishwasher)	**2**	X		=	
Sink, service	3	X		=	
Utility Tub or Sink	**2**	X		=	
Water Closet (toilet), 1.6 GPF	**3**	X		=	
Water Closet (toilet), >1.6 – 3.2 GPF	4	X		=	
Water Closet (toilet), >3.2 GPF	6	X		=	
				TOTAL FIXTURE UNITS:	

Items in BOLD are the most commonly used fixtures

"Bedroom" means, for the purposes of determining design flow for an on-site wastewater treatment facility for a dwelling, any room that has:

a) Floor space of at least 70 square feet in area, excluding closets;
b) Ceiling height of at least 7 feet;
c) Electrical service and ventilation;
d) A closet or an area where a closet could be constructed;
e) At least one window capable of being opened and used for emergency egress; and
f) A method of entry and exit into the room which allows it to be considered distinct from other rooms in the dwelling to afford a level of privacy customarily expected for such a room.

Bedroom/Equivalent Worksheet	
Room Type	*Number of Rooms*
Bedroom	
Den	
Office	
Other:	
Other:	
Other:	
Total:	

TYPE OF CHAMBER (CHECK ONE): **QUICK4 PLUS STANDARD LP** ☐ **QUICK4 HIGH CAPACITY** ☐ **ARC 36LP** ☐ **ARC 36 HC** ☐

TANK SIZE (*from Septic System Sizing Chart*) = _____

DESIGN FLOW (*from Septic System Sizing Chart*) = _____

PERCOLATION RATE
(*from the Soils Report or Disposal Area Calculation Table*) = _____

SOIL ABSORPTION RATE
(*from the Soils Report or Disposal Area Calculation Table*) = _____

TOTAL SQUARE FOOTAGE REQUIRED
(*divide DESIGN FLOW by SAR or use Design Flow Calculation Table*) = _____

- QUICK4 PLUS STANDARD LP — divisor is **24.62** per unit
- QUICK4 HIGH CAPACITY — divisor is **28.40** per unit
- ARC 36LP — divisor is **29.75** per unit
- ARC 36 HC — divisor is **34.43** per unit

DIVISOR USED (provided and recommended by manufacturer) = _____

TOTAL NUMBER OF CHAMBERS *(divide the TOTAL SQUARE FOOTAGE by the DIVISOR)* = _____

TOTAL LINEAR LENGTH OF TRENCH REQUIRED *(multiply NUMBER of CHAMBERS by CHAMBER LENGTH:QUICK 4 = 4',ARC 36 = 5' per chamber)* = _____

Proposed Number of Trenches	
Proposed Number of Chambers per Trench	
Proposed Width of each Trench	3
Proposed Length of each Trench	
Proposed Overall Depth of each Trench	
Separation Between Trench Edges	5

- The maximum length for any disposal field is 100'. If the total linear length of trench is greater than 100', use a distribution box to divide the total length into multiple trenches of equal length to distribute the effluent more effectively throughout the disposal field.
- The separation between the chamber trench walls is a minimum of 5'.
- For contoured installations, chambers can swivel up to 10 degrees, left or right.

Prinsco Chamber Worksheet

Permit/File #: _____ Designed by: _____ Date: _____

FIXTURE COUNT CALCULATION CHART					
FIXTURE TYPE	*UNIT*		*# OF FIXTURES*		*TOTAL FIXTURE UNITS*
Bath Tub	**2**	X		=	
Bidet	2	X		=	
Clothes Washer	**2**	X		=	
Dishwasher (separate from kitchen)	2	X		=	
Lavatory (bathroom sink), single	**1**	X		=	
Lavatory, double in master bedroom	**1**	X		=	
Shower, single stall	**2**	X		=	
Sink, bar	**1**	X		=	
Sink, kitchen (including dishwasher)	**2**	X		=	
Sink, service	3	X		=	
Utility Tub or Sink	**2**	X		=	
Water Closet (toilet), 1.6 GPF	**3**	X		=	
Water Closet (toilet), >1.6 – 3.2 GPF	4	X		=	
Water Closet (toilet), >3.2 GPF	6	X		=	
				TOTAL FIXTURE UNITS:	

Items in BOLD are the most commonly used fixtures

"Bedroom" means, for the purposes of determining design flow for an on-site wastewater treatment facility for a dwelling, any room that has:

a) Floor space of at least 70 square feet in area, excluding closets;
b) Ceiling height of at least 7 feet;
c) Electrical service and ventilation;
d) A closet or an area where a closet could be constructed;
e) At least one window capable of being opened and used for emergency egress; and
f) A method of entry and exit into the room which allows it to be considered distinct from other rooms in the dwelling to afford a level of privacy customarily expected for such a room.

Bedroom/Equivalent Worksheet	
Room Type	*Number of Rooms*
Bedroom	
Den	
Office	
Other:	
Other:	
Other:	
Total:	

TYPE OF CHAMBER (CHECK ONE): **PRINSCO PRO436LP** ☐ **PRINSCO PRO436** ☐ **PRINSCO PRO436HC** ☐

TANK SIZE (*from Septic System Sizing Chart*) = _____

DESIGN FLOW (*from Septic System Sizing Chart*) = _____

PERCOLATION RATE
(*from the Soils Report or Disposal Area Calculation Table*) = _____

SOIL ABSORPTION RATE
(*from the Soils Report or Disposal Area Calculation Table*) = _____

TOTAL SQUARE FOOTAGE REQUIRED
(*divide DESIGN FLOW by SAR or use Design Flow Calculation Table*) = _____

- Prinsco Pro436LP — divisor is **24.73** per unit
- Prinsco Pro436 — divisor is **26.07** per unit
- Prinsco Pro436HC — divisor is **28.53** per unit

DIVISOR USED (provided and recommended by manufacturer) = _____

TOTAL NUMBER OF CHAMBERS *(divide the TOTAL SQUARE FOOTAGE by the DIVISOR)* = _____

TOTAL LINEAR LENGTH OF TRENCH REQUIRED *(multiply NUMBER of CHAMBERS by CHAMBER LENGTH: Prinsco Pro436 = 4' per chamber)* = _____

Proposed Number of Trenches	
Proposed Number of Chambers per Trench	
Proposed Width of each Trench	3
Proposed Length of each Trench	
Proposed Overall Depth of each Trench	
Separation Between Trench Edges	5

- The maximum length for any disposal field is 100'. If the total linear length of trench is greater than 100', use a distribution box to divide the total length into multiple trenches of equal length to distribute the effluent more effectively throughout the disposal field.
- The separation between the chamber trench walls is a minimum of 5'.
- For contoured installations, chambers can swivel up to 10 degrees, left or right.

EZflow EPS Aggregate System Worksheet

FIXTURE COUNT CALCULATION CHART					
FIXTURE TYPE	*UNIT*		*# OF FIXTURES*		*TOTAL FIXTURE UNITS*
Bath Tub	**2**	X		=	
Bidet	2	X		=	
Clothes Washer	**2**	X		=	
Dishwasher (separate from kitchen)	2	X		=	
Lavatory (bathroom sink), single	**1**	X		=	
Lavatory, double in master bedroom	**1**	X		=	
Shower, single stall	**2**	X		=	
Sink, bar	**1**	X		=	
Sink, kitchen (including dishwasher)	**2**	X		=	
Sink, service	3	X		=	
Utility Tub or Sink	**2**	X		=	
Water Closet (toilet), 1.6 GPF	**3**	X		=	
Water Closet (toilet), >1.6 – 3.2 GPF	4	X		=	
Water Closet (toilet), >3.2 GPF	6	X		=	
				TOTAL FIXTURE UNITS:	

Items in BOLD are the most commonly used fixtures

"Bedroom" means, for the purposes of determining design flow for an on-site wastewater treatment facility for a dwelling, any room that has:

a) Floor space of at least 70 square feet in area, excluding closets;
b) Ceiling height of at least 7 feet;
c) Electrical service and ventilation;
d) A closet or an area where a closet could be constructed;
e) At least one window capable of being opened and used for emergency egress; and
f) A method of entry and exit into the room which allows it to be considered distinct from other rooms in the dwelling to afford a level of privacy customarily expected for such a room.

Bedroom/Equivalent Worksheet	
Room Type	*Number of Rooms*
Bedroom	
Den	
Office	
Other:	
Other:	
Other:	
Total:	

TRENCHES HAVE A MAXIMUM OVERALL DEPTH OF FIVE (5) FEET ABOVE DEPTH OF TEST HOLE

TANK SIZE (*from Septic System Sizing Chart*) = _____

DESIGN FLOW (*from Septic System Sizing Chart*) = _____

PERCOLATION RATE (*from the Soils Report or Disposal Area Calculation Table*) = _____

SOIL ABSORPTION RATE (*from the Soils Report or Disposal Area Calculation Table*) = _____

TOTAL SQUARE FOOTAGE REQUIRED (*divide DESIGN FLOW by SAR or use Design Flow Calculation Table)* = _____

EZFLOW CONFIGURATION *(refer to EZFLOW Design Table; select from drop down list)* =

DIVISOR USED (refer to EZFLOW Design Table) = _____

TOTAL LINEAR LENGTH OF TRENCH REQUIRED (*divide TOTAL SQUARE FOOTAGE by DIVISOR***)** = _____

Proposed Number of Trenches _____

Proposed Length of each Trench _____

Proposed Width of each Trench _____

Proposed Overall Depth of each Trench _____

Separation Between Trench Edges _____

- The maximum length for any disposal field is 100'. If the total linear length of trench is greater than 100', use a distribution box to divide the total length into multiple trenches of equal length to distribute the effluent more effectively throughout the disposal field.
- The separation between the trench walls is a minimum of 5' or twice the effective depth, whichever is greater.

Permit/File #: _____ **Designed by:** _____ **Date:** _____

ON-SITE WASTEWATER SYSTEM
PLOT PLAN

(for 4.02 General Permit only. 4.02-4.22 must provide construction quality drawings)

Address:	☐ **North Arrow shown**
Assessor Parcel:	☐ **Boundaries of property shown on plan**
Legal Description:	☐ **Proposed/existing systems, dwellings, buildings, driveways, swimming pools, tennis courts, wells, ponds, and any paved, concrete or water feature, shown.**
	☐ **Slopes and cut banks greater than 15%, retaining walls and other constructed features shown**
	☐ **Any feature less than 200 ft. from facility and reserve area that constrains the location due to setback limitations shown**
	☐ **Topography shown with contour intervals, showing original and post-installation grades**
Property Size (in acres):	☐ **EXACT LOCATION of all soils testing and percolation sites**
Engineer's Scale (max 1"=60'):	☐ **Location of the treatment and disposal works, pipelines, reserve area**
Permit Number:	☐ **Location of any public sewer if less than 400 ft. from property line**

Proper construction and installation of this system shall follow all applicable Federal, State, County and City laws. Mohave county disclaims any responsibility of the construction, installation, errors or omissions involved with this system and the sole responsibility for any of the above is with the owner or his/her contractor (s) and/or agents (s). The as-built drawing is provided for ease and convenience to locate the system in the future and not for construction purposes.

The information within the plot plan submitted is true and accurate to the best of my knowledge;

_____ Date: _____

Signature Title

MOHAVE COUNTY
DEVELOPMENT SERVICES

P. O. Box 7000 Kingman, Arizona 86402-7000 3250 E. Kino Ave, Kingman www.mohave.gov Telephone (928) 757-0903

SEWER AVAILABILITY INFORMATION SHEET

Service Provider/Company Name:	Submitted by:		
	Telephone:		
	Fax:		
Date:			
Name of Property Owner:			
Location Address:			
Subdivision:	Tract:	Block:	Lot:
Assessor Parcel Number:			

Indicate below what type of project will be constructed on the above mentioned property:

☐ Residential (Single Family Only)	
☐ Commercial/Multi-family	Estimate flow rate in gallons per day:
☐ Industrial	Estimate flow rate in gallons per day:

Flood Zone:

Applicant Signature:

Per an inquiry with the above-referenced service provider regarding the availability of sanitary sewer to serve the above-referenced location, sewer is available at property:

☐ Yes, sewer is available and will be connected to
☐ No, sewer connection exceeds fees of R18-9-A309(A)(5)(b) (Engineers/Contractor's Estimate req.)
☐ N/A, no sewer service provider in subdivision

DISCLAIMER: For North Kingman / New Kingman Addition / Butler: if property is greater than 100' but less than 500' from City of Kingman Sewer, opting to use on an onsite wastewater system may result in the City of Kingman denying water service should an existing water meter not exist on the property at the time of septic permit issuance.

Does this property have an existing water meter: ☐ YES ☐ NO

Distance to sewer: feet

Comments: _____

Sewer Provider Representative Signature:

MOHAVE COUNTY
DEVELOPMENT SERVICES

P. O. Box 7000 Kingman, Arizona 86402-7000 3250 E. Kino Ave, Kingman www.mohave.gov Telephone (928) 757-0903

Scott Holtry
Department Director

J. David Strahl
County Manager

TEMPORARY INDIVIDUAL WASTE DISPOSAL SYSTEM ACKNOWLEDGEMENT

I, _____, the owner of property located in the

_____Subdivision, Tract_____, Block_____, Lot_____,

understand that the onsite wastewater treatment and disposal system being installed to service the above-described property is a temporary system. In the event that sewer becomes available to this property and if the system is damaged, fails, or is otherwise rendered inoperable or in need of expansion I hereby acknowledge that I will be required to abandon such system in a method approved by the Mohave County Environmental Quality Department, and connect to the municipal sewer system servicing the property in accordance with the requirements of Ariz. Admin. Code § R18-9-A309.A.5.

The Mohave County Development Services Department, Environmental Quality/Waste Management Division is to be notified prior to abandonment of the system.

ASSESSOR'S PARCEL #_____

_____ _____

SIGNATURE OF PROPERTY OWNER DATE